


See Drawings 11091 & 11092 for detail

Panel Sounder

Global Indications and Controls

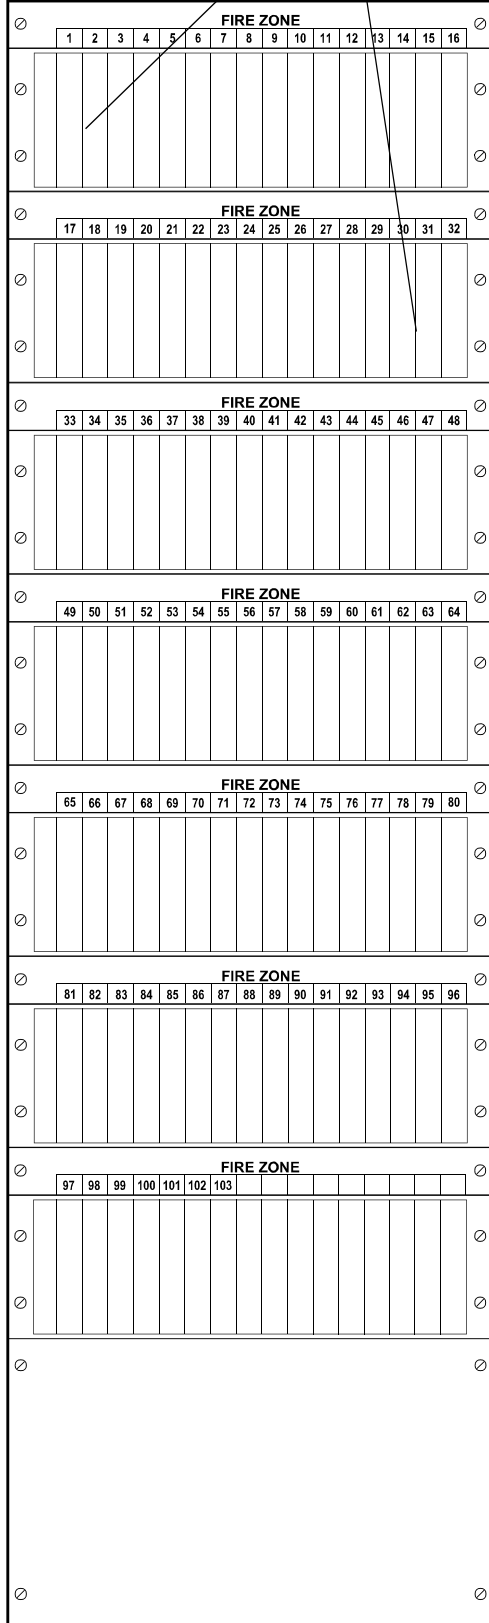

2nd STAGE FIRE

1st STAGE FIRE

FAULT

ZONE ISOLATED

MON. SUPPLY

ACT. SUPPLY

ACTUATION OFF AUTO TEST

SILENCE

RESET

LAMP TEST

SUPPLY FAULT

INPUT SUPPLY

Typical Rack Cubicle Example Fascia Controls

Title:-

Drawing Ref.

11097\_01.wpg

CAD Ref.

11/06/05

Original

1

Change Ref.

Issue

Date

Patol Limited  
Rectory Rd, Padworth Common, Berkshire.  
Tel: 0118 9701701 Fax: 0118 9701700

11097