


Note : Patol can produce special control panels to customer requirements

**Patol Limited**  
 Rectory Rd, Padworth Common, Berkshire.  
 Tel: 0118 9701701 Fax: 0118 9701700

1	ORIGINAL	15/06/06
Issue	Change Ref.	Date

Title:- <b>Typical Dual Infra-red Detector Control Panel General Arrangement</b>		
CAD Ref.	11051_01.wpg	Drawing Ref. <b>11051</b>

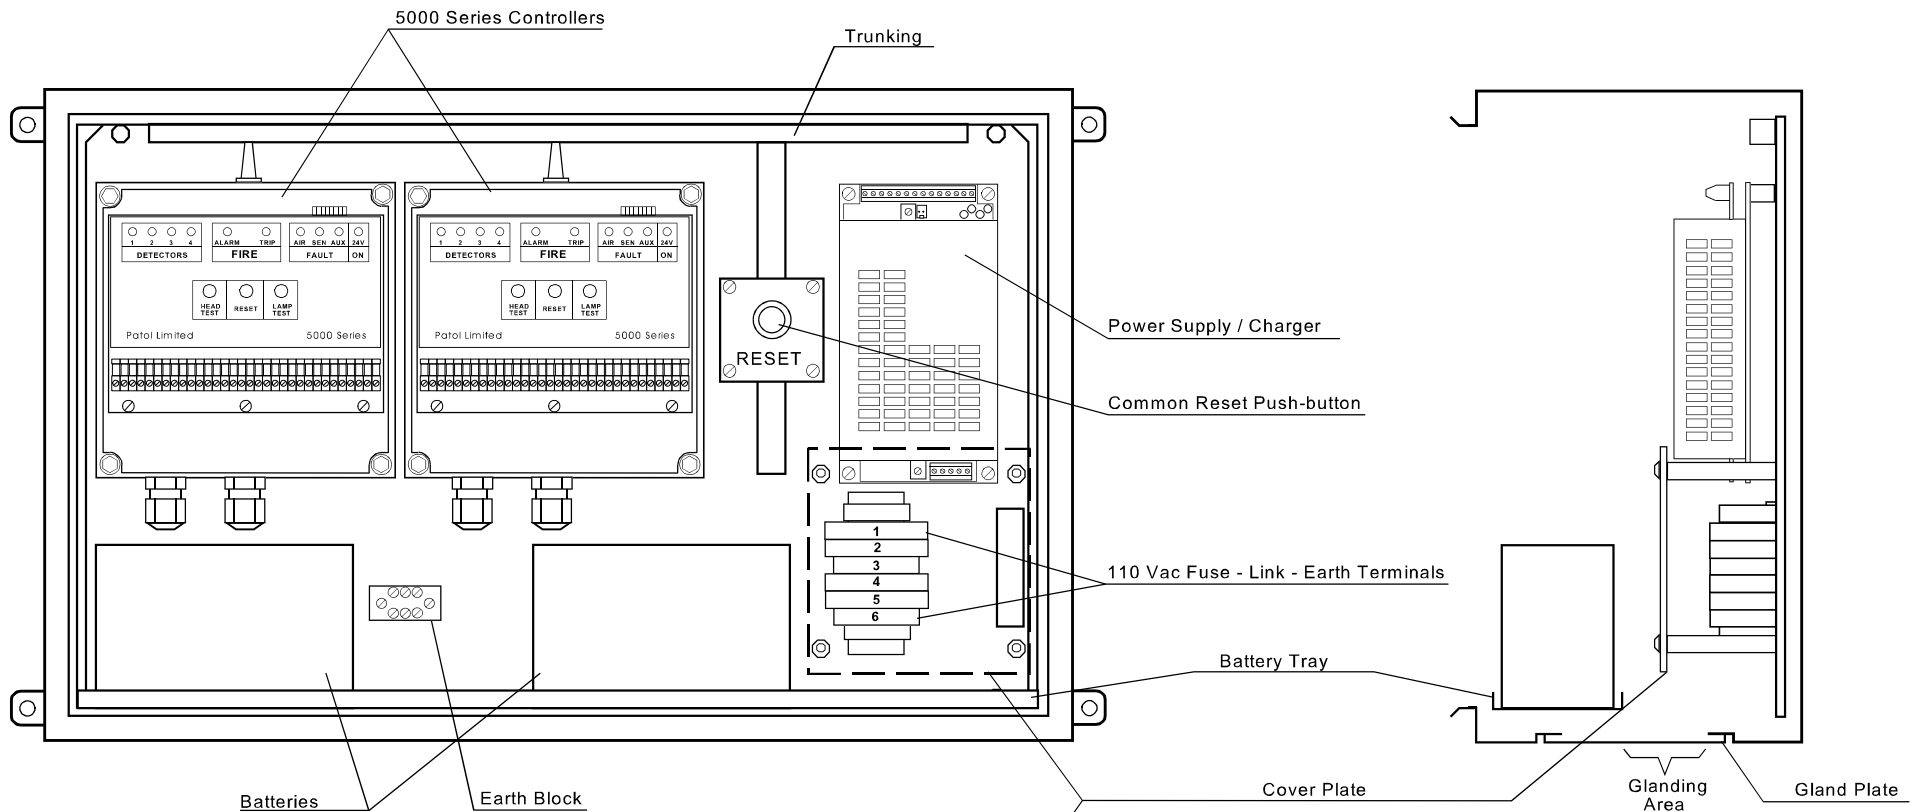


INTERNAL VIEW ( Door Removed)

SECTIONAL VIEW ( Door Removed)

**FUSES** - All 20mm Anti-surge Ceramic

Value	Function	Location
5A	110 Vac Input Supply	Rail Terminal 1
2A	110 Vac Blower Feed	Rail Terminal 4
3.15A	PSU/Charger Input	Under PSU Cover
4A	Battery Protection	Under PSU Cover



Note : Patol can produce special control panels to customer requirements

**Patol Limited**

Rectory Rd, Padworth Common, Berkshire.  
Tel: 0118 9701701 Fax: 0118 9701700

1	ORIGINAL	15/06/05
Issue	Change Ref.	Date

Title:- <b>Typical Dual Infra-red Detector Control Panel Internal Arrangement</b>	
CAD Ref. 11052_01.wpg	Drawing Ref. <b>11052</b>